



(a) Termination 10 ft (3 m) or Less from Ridge, Wall, or Parapet

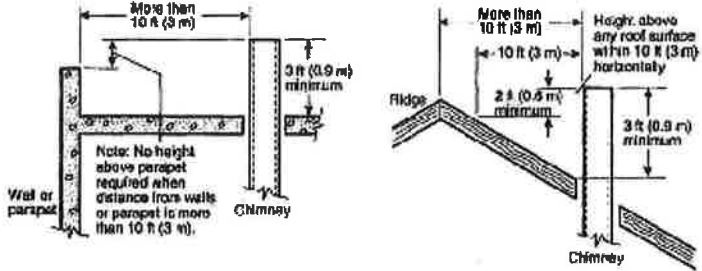

Location of the termination of the venting system should comply with the National Fuel Gas Code, A.N.S.I. Z223.1, manufacturer's recommendations and/or applicable local codes. See Diagram for typical terminal locations.

- A. The exit termination of a mechanical draft system must not be less than 7' above grade when located adjacent to a public walkway.*
- B. The venting systems with the exception of direct vent appliances, must terminate at least 4' below, 4' horizontally, or 1' above any door, window or gravity air inlet into the building.
- C. A venting system must terminate at least 3' above any forced air inlet located within 10'.
- D. The bottom of the vent terminal must be located at least 1' above finished grade.**
- E. The vent termination should not be mounted directly above or within 3' horizontally from an oil tank vent or gas meter (not shown in image).
- F. The vent termination point must not be installed closer than 3' from an inside corner of an L-shaped structure.

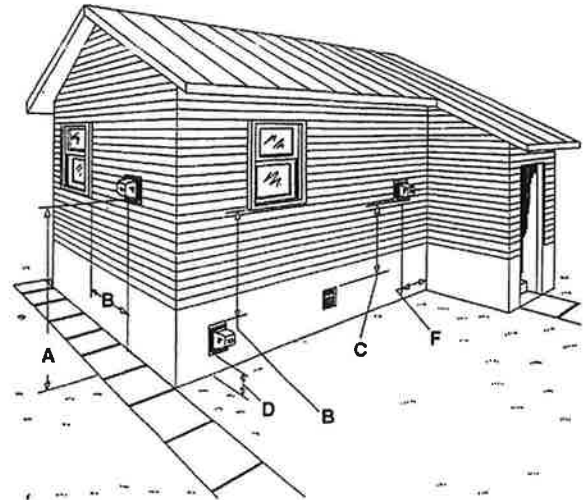

*10" or larger should be 10 ft. minimum above public walkway.
 **10" or larger should be 4 ft. above finished grade.